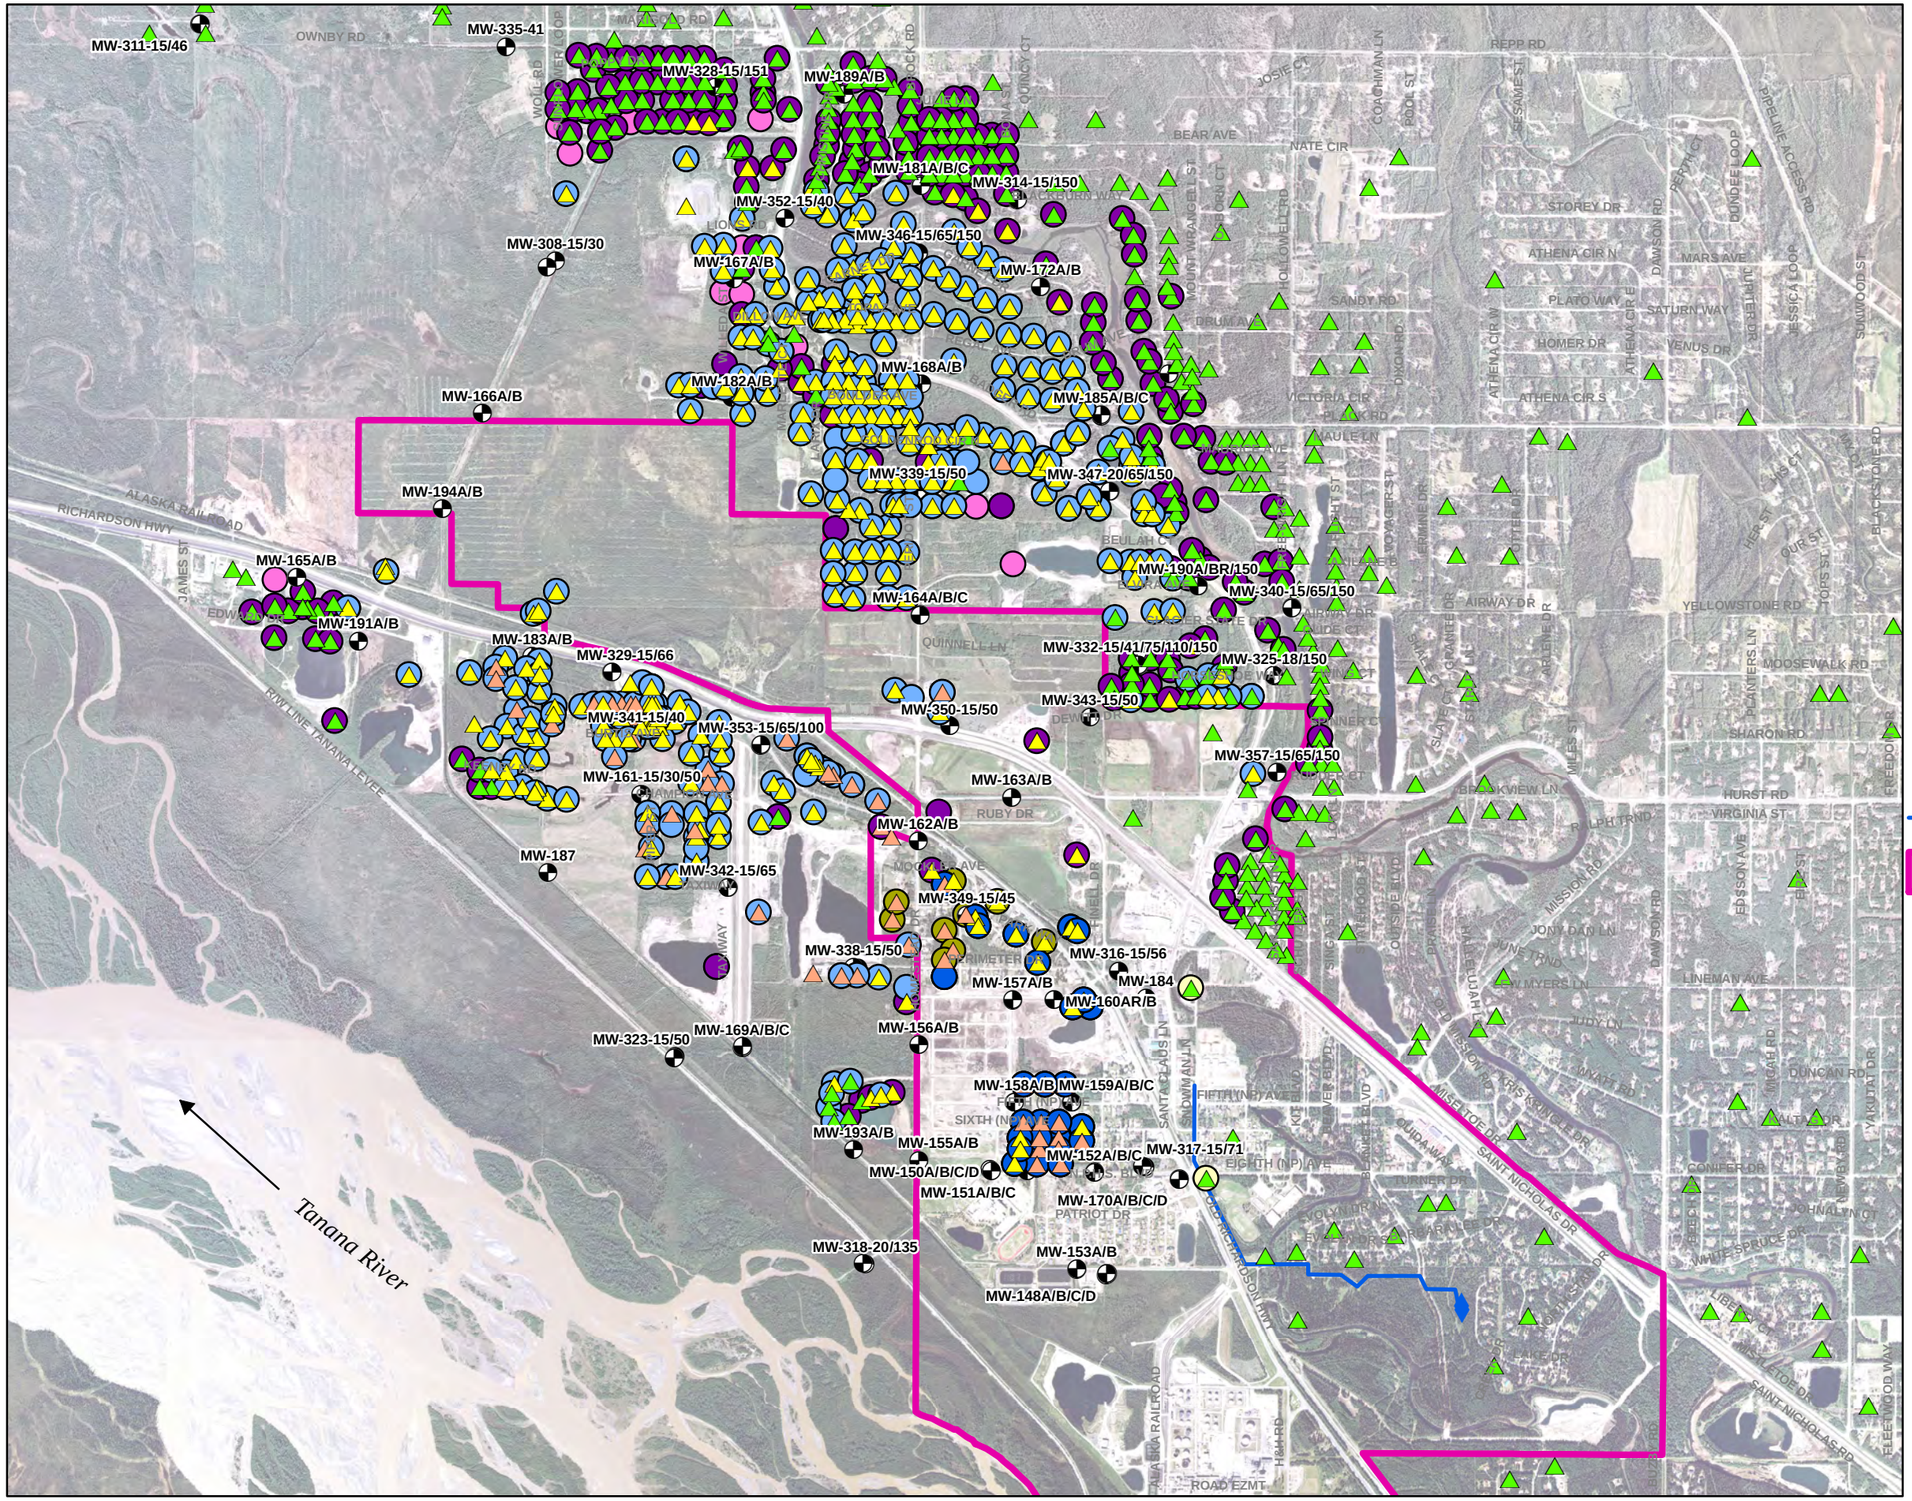

Legend

- Sulfolane Not Detected
- 2.50 - 100 µg/L
- 100 - 1,000 µg/L
- Monitoring Well
- City Water Solutions
- Long Term Alternative Water Solution - Residential Property
- Long Term Alternative Water Solution - Commercial Property
- Interim Bottled Water Solution
- Water Tank Listed As Water Source During Survey (Outside City Limits)
- Auxiliary Well Sample, City Water Listed As Drinking Water Source During Survey
- City of North Pole Fire Wells
- New NP City Wells
- Water Main New City Wells
- North Pole City Boundary

Notes:
ppb = parts per billion
1 ppb = 1 µg/L (microgram per liter)
1 µg/L - 0.000000001 g/L (gram per liter)
*The latest sulfolane result for a well is presented on this map, as of December 2016.

0 1
Miles

Alternative Water Solutions Program - 2016 Annual Report
North Pole, Alaska

POTABLE WATER SOLUTIONS PROVIDED BY FLINT HILLS RESOURCES

Feb 2017 31-1-11807-001

SHANNON & WILSON, INC. GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS

Figure 3